



Size distribution of particles released from the oral cavity

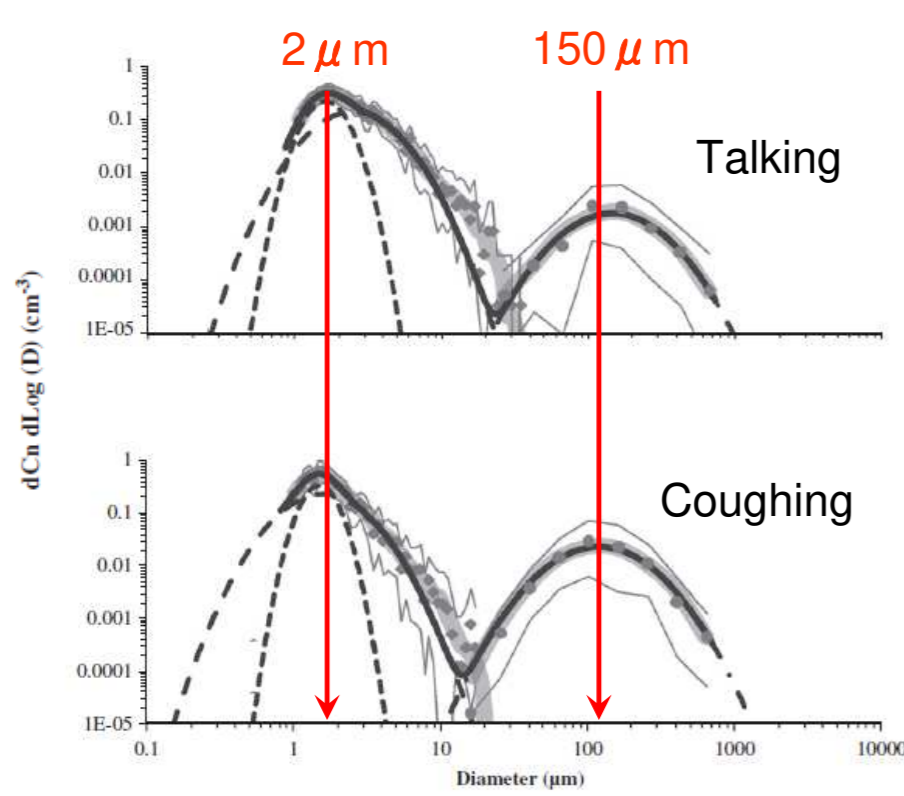

In medical studies, particles released from oral cavity are distinguished between **aerosols** and **droplets** at a diameter of $5 \mu\text{m}$.


The actual size distribution of particles released from the oral cavity is two-peaked, with $150 \mu\text{m}$ **droplets** falling in about two seconds and reaching only about two meters, while $2 \mu\text{m}$ **aerosols** drift in the air for a long time. In some cases, the droplets is dehydrated to form aerosol-sized droplet nuclei.

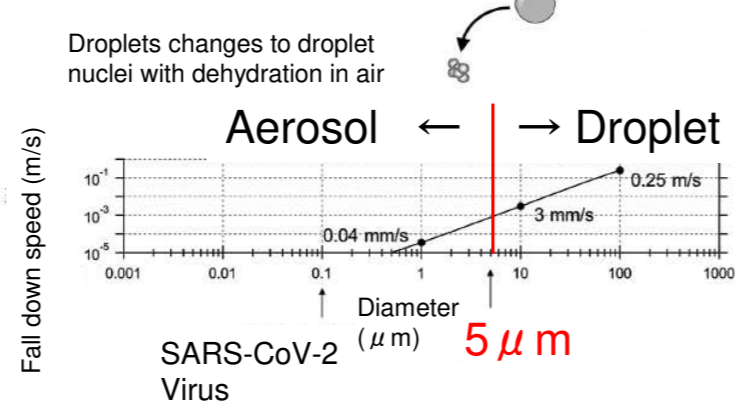

G.R. Jhonson et al., Modality of human expired aerosol size distributions, J. Aerosol Science, 42(2011)839-851.


Nobuyuki Takegawa, Aerosol, Droplet Transmission, and Airborne Transmission, Eiarozoru Kenkyu, 36 (2021) 65-74.

A specialized device that removes droplets flying between person-and-person

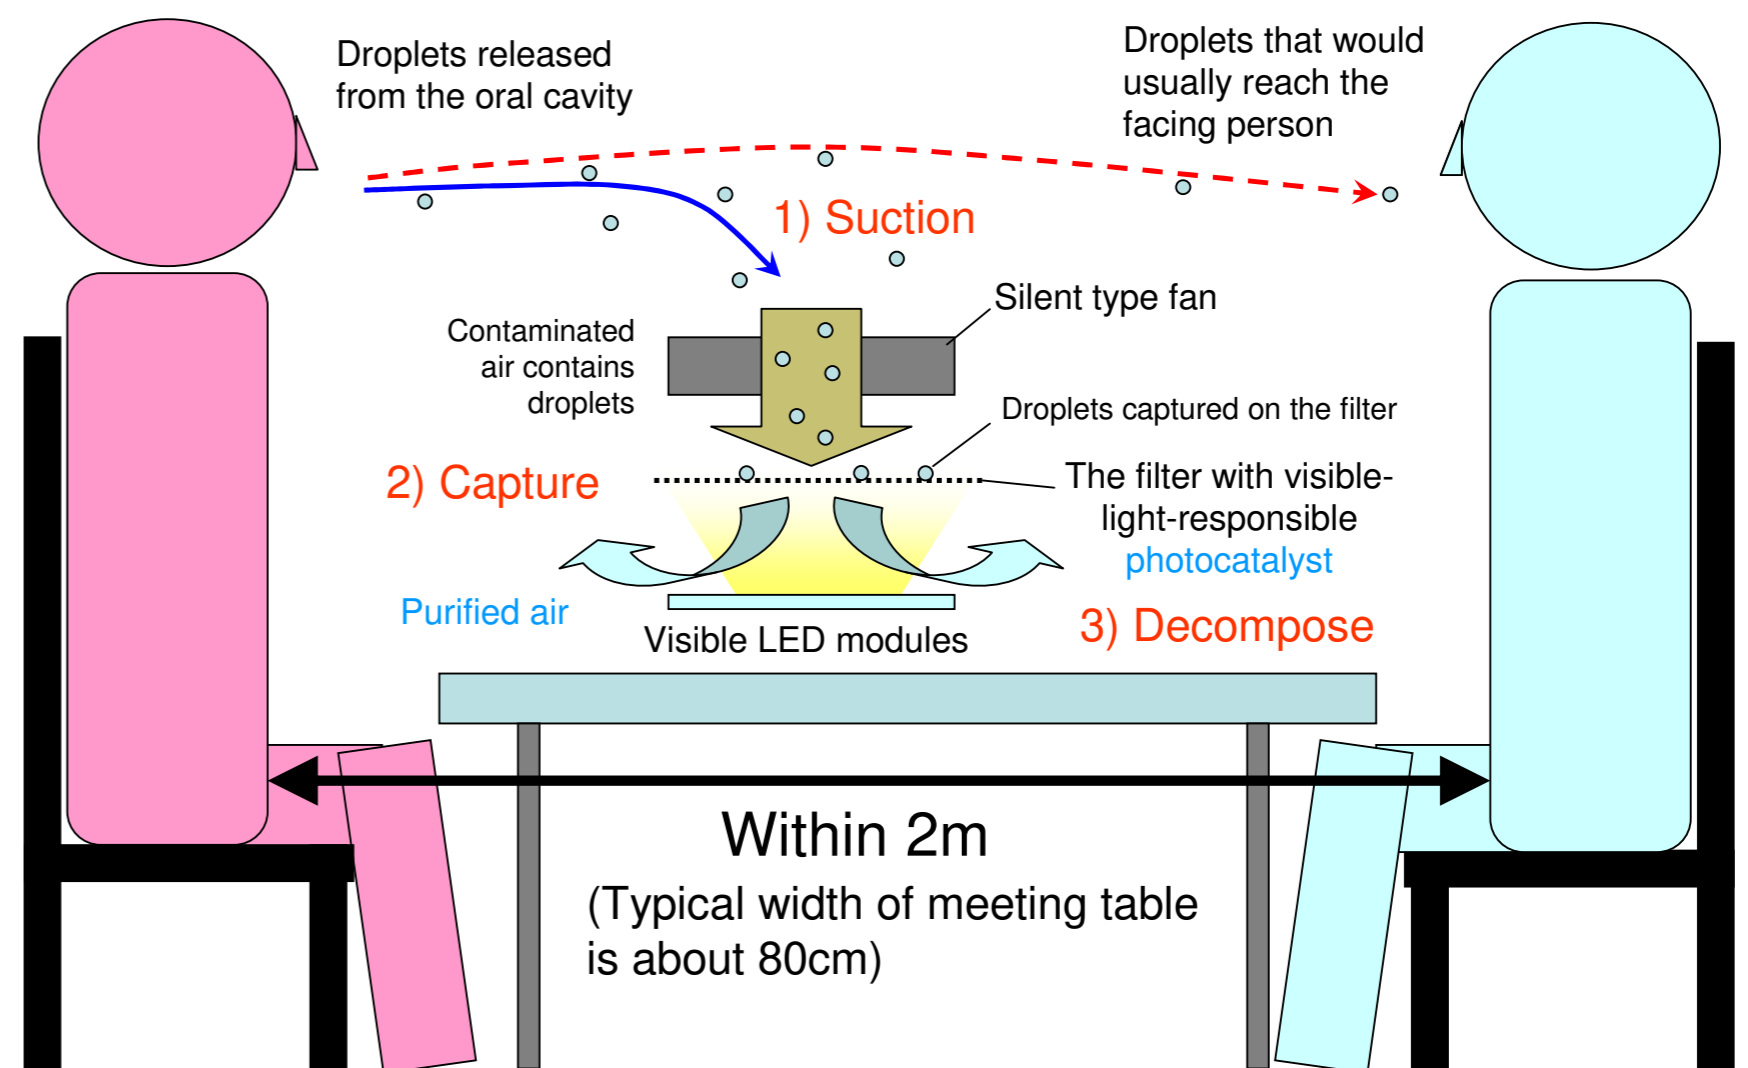

Ultra-low-cost droplet removal system "Hikari Cleaner" using visible light responsive photocatalyst

NOT commercial product

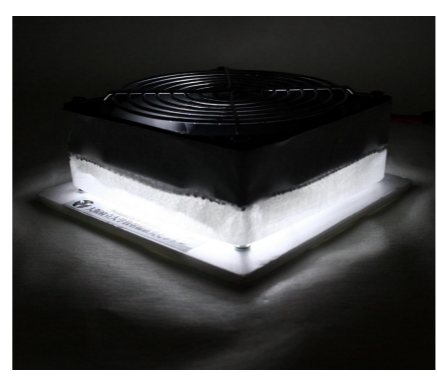

Shading leaked light with Japanese paper


Luminary light between person-and-person

Using visible light-responsive photocatalyst, it does not need to be completely shielded from leaking light and can be made with a **simple structure**. It is made by combining commercial PC parts, therefore it cost only **1200 yen per unit**. The photocatalyst filter can be manufactured with a simple non-woven fabric filter and Toshiba's "Renecat" spray, which is commercially available. The suction performance can be improved by using a more powerful fan.




The size is **12 cm square** and 5 cm high. Fan noise is only **19 dB**. Power consumption is less than 5 W, and can be powered by a mobile battery

Light (Photon)

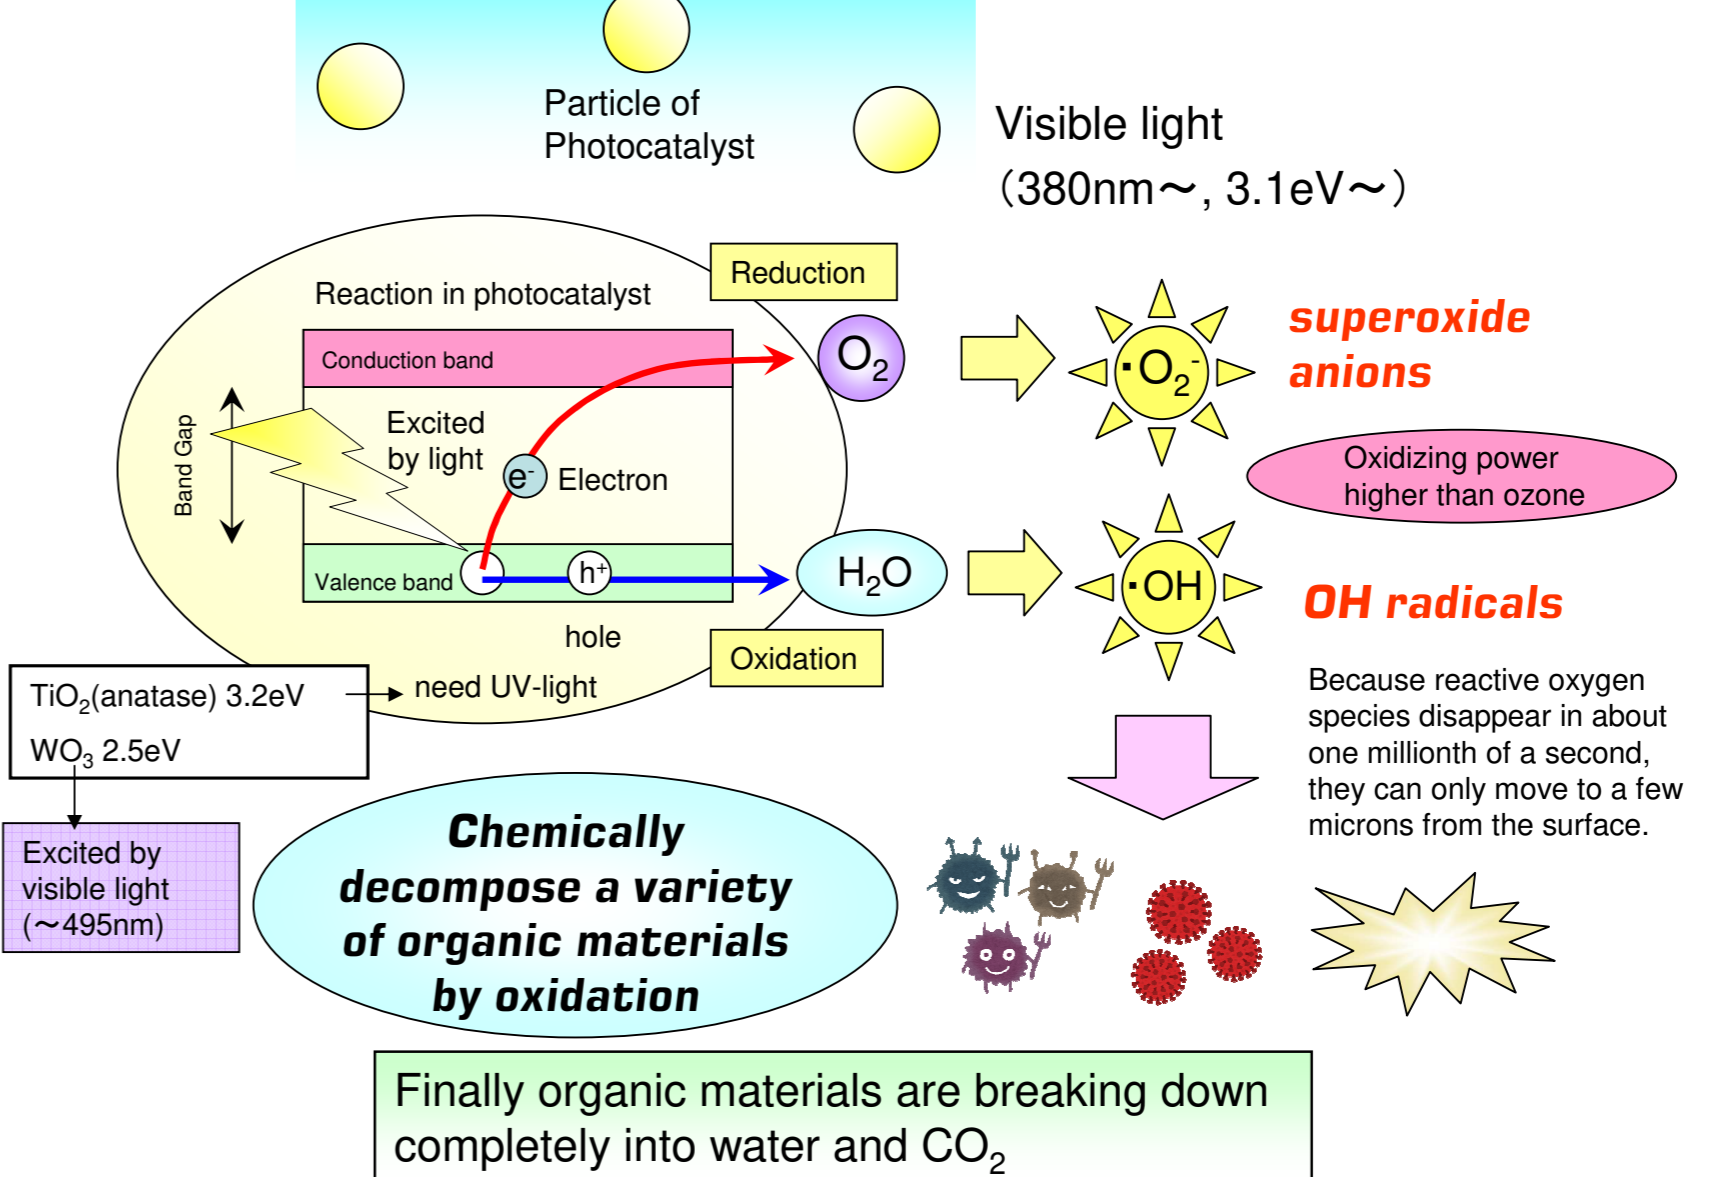

Visualization of droplet suction by special imaging system

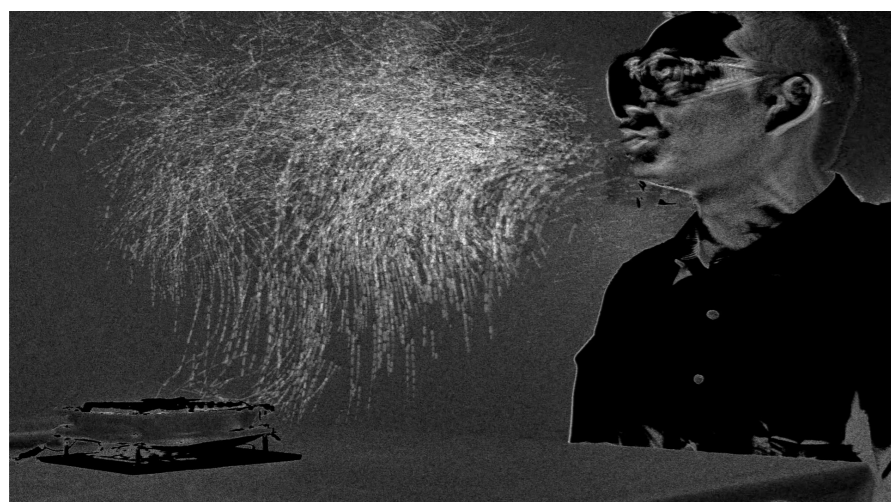

Special video recording was conducted to visualize droplets in the air. Within a range of about 50cm, we can see that droplets emitted by the oral cavity with a "booming" sound are **inhaled and stopped by the filter** in the same way as a mask.




Transmittance rate of droplets to a filter



A duct was set up in a clean booth using HEPA filter unit, and the rate at which ultrasonic sprayer mist, simulating droplets from the oral cavity, was captured by a non-woven fabric filter was evaluated. As a result, it was confirmed that **droplets of $5 \mu\text{m}$ or larger could be almost completely captured**.




Catching and slowly decomposing

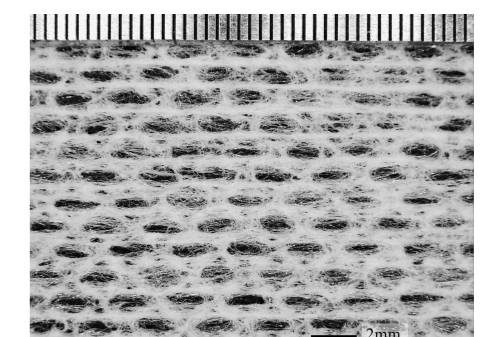

The non-woven fabric filter used in this study

Condition	Particle Size μm	Concentration of particles		Transmittance
		before the filter m^{-3}	after the filter m^{-3}	
with a little air dust	0.3~1	7.4×10^5	2.7×10^5	0.37
	1~5	5.1×10^4	1.7×10^4	0.34
	5~25	9.0×10^2	1.8×10^2	0.20
in the clean booth	0.3~1	1.2×10^4	6.7×10^3	0.54
	1~5	1.4×10^2	1.8×10^1	0.13
	5~25	2.0×10^1	0	0
with a nebulizer (1st, dual nozzle)	0.3~1	4.1×10^5	4.6×10^5	1.14
	1~5	1.2×10^4	3.6×10^3	0.30
	5~25	3.7×10^2	2.1×10^2	5.8×10^{-5}
with a nebulizer (2nd, single nozzle)	0.3~1	2.8×10^5	2.5×10^5	0.87
	1~5	2.6×10^4	1.0×10^4	0.40
	5~25	3.0×10^3	1.8×10^1	6.0×10^{-5}
with a nebulizer (3rd, single nozzle)	0.3~1	2.7×10^5	2.7×10^5	0.99
	1~5	2.0×10^4	1.5×10^4	0.76
	5~25	1.1×10^3	5.3×10^1	4.7×10^{-4}



Collection rate of droplets flying in space

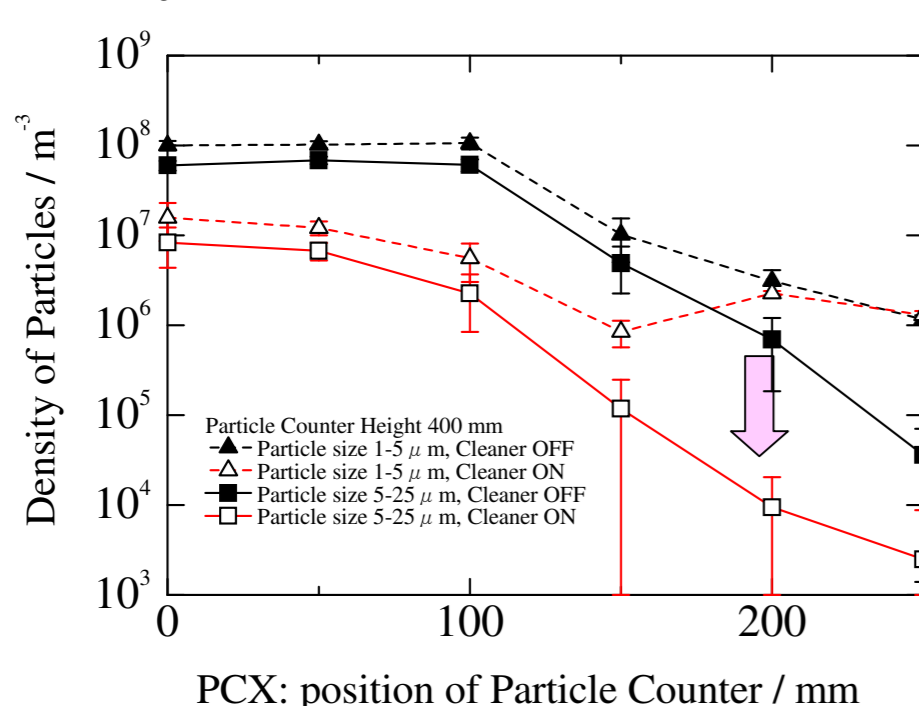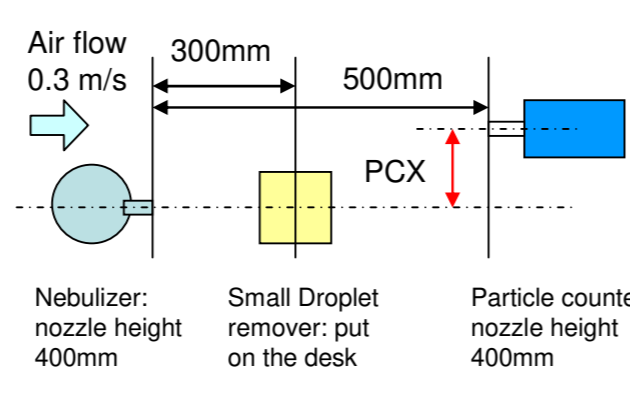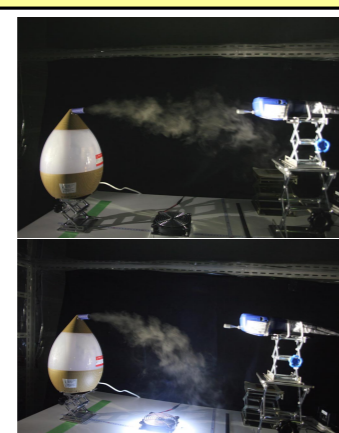


Performance of the small droplet remover in open space was estimated using large clean booth. Particle counters were placed off-center axis of nebulizer and the remover. The nozzle of the nebulizer was set horizontally and the **mist flew almost straight** with a following wind of 0.3 m/s from air purifier units.

Large droplets with diameters of 5.0 to 25 μm were reduced to about 1/10 in all position. **Aerosols** of 1.0 to 5.0 μm , which are close to the **peak diameter** of the aerosol emitted from the actual oral cavity, were also reduced to about 1/10 from center to 15cm, but at 20 and 25cm almost no reduction was observed.

Decompose performance for organic gas and virus in aerosol

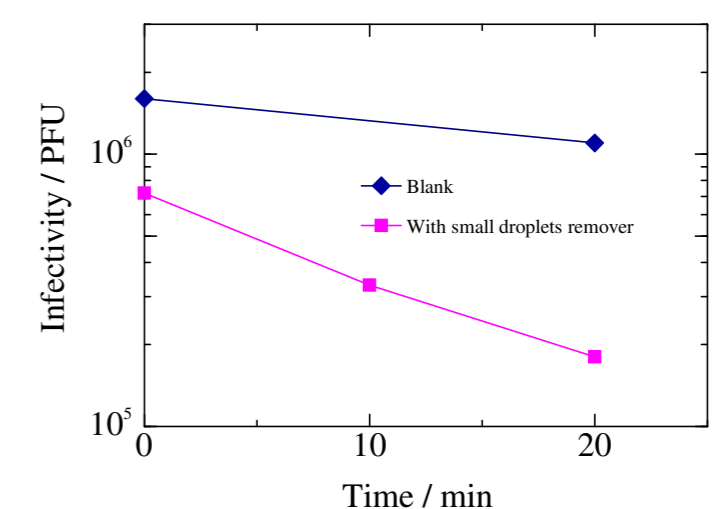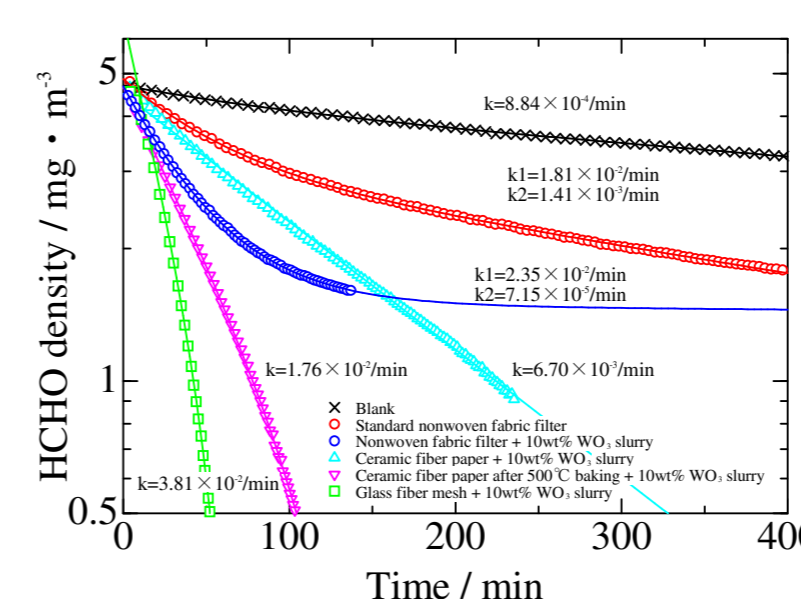

A solution containing **bacteriophage Q β** was sprayed with a nebulizer in a 370 L glove box to make an **aerosol**. At the measurement time, 10 L air was sampled through a gelatin filter and the infectivity was evaluated by the plaque method.

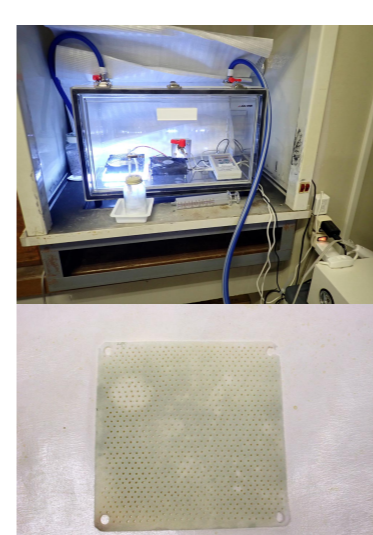

Using a 38L size acrylic desiccator, changes in the concentration of formaldehyde (HCHO), a kind of organic gas, were measured using a formaldehyde meter hV-m. The non-woven fabric filter that was initially used was organic, so there was a limit to the improvement in performance even if the amount of photocatalyst loaded was increased. A filter made of inorganic material was used, and by applying appropriate pretreatment, a significant improvement in performance was achieved.

Although **aerosols** suspended in the air for long time **cannot be caught by the rough filter**, it was suggested that the small droplet remover using a photocatalyst can **inactivate** viruses contained in aerosols.